

VESDA[®] by Xtralis

Chemical Filter for Corrosive Environments

Application Note

April 2018

Doc. 14888_06

Disclaimer

The contents of this document is provided on an "as is" basis. No representation or warranty (either express or implied) is made as to the completeness, accuracy or reliability of the contents of this document. The manufacturer reserves the right to change designs or specifications without obligation and without further notice. Except as otherwise provided, all warranties, express or implied, including without limitation any implied warranties of merchantability and fitness for a particular purpose are expressly excluded.

Intellectual Property and Copyright

This document includes registered and unregistered trademarks. All trademarks displayed are the trademarks of their respective owners. Your use of this document does not constitute or create a licence or any other right to use the name and/or trademark and/or label. This document is subject to copyright owned by Xtralis. You agree not to copy, communicate to the public, adapt, distribute, transfer, sell, modify or publish any contents of this document without the express prior written consent of Xtralis.

General Warning

This product must only be installed, configured and used strictly in accordance with the General Terms and Conditions, User Manual and product documents available from Xtralis. All proper health and safety precautions must be taken during the installation, commissioning and maintenance of the product. The system should not be connected to a power source until all the components have been installed. Proper safety precautions must be taken during tests and maintenance of the products when these are still connected to the power source. Failure to do so or tampering with the electronics inside the products can result in an electric shock causing injury or death and may cause equipment damage. Xtralis is not responsible and cannot be held accountable for any liability that may arise due to improper use of the equipment and/or failure to take proper precautions. Only persons trained through an Xtralis accredited training course can install, test and maintain the system.

Liability

You agree to install, configure and use the products strictly in accordance with the User Manual and product documents available from Xtralis.

Xtralis is not liable to you or any other person for incidental, indirect, or consequential loss, expense or damages of any kind including without limitation, loss of business, loss of profits or loss of data arising out of your use of the products. Without limiting this general disclaimer the following specific warnings and disclaimers also apply:

Fitness for Purpose

You agree that you have been provided with a reasonable opportunity to appraise the products and have made your own independent assessment of the fitness or suitability of the products for your purpose. You acknowledge that you have not relied on any oral or written information, representation or advice given by or on behalf of Xtralis or its representatives.

Total Liability

To the fullest extent permitted by law that any limitation or exclusion cannot apply, the total liability of Xtralis in relation to the products is limited to:

- (i) in the case of services, the cost of having the services supplied again; or
- (ii) in the case of goods, the lowest cost of replacing the goods, acquiring equivalent goods or having the goods repaired.

Indemnification

You agree to fully indemnify and hold Xtralis harmless for any claim, cost, demand or damage (including legal costs on a full indemnity basis) incurred or which may be incurred arising from your use of the products.

Miscellaneous




If any provision outlined above is found to be invalid or unenforceable by a court of law, such invalidity or unenforceability will not affect the remainder which will continue in full force and effect. All rights not expressly granted are reserved.

Document Conventions

The following typographic conventions are used in this document.

Convention	Description
Bold	Used to denote: emphasis Used for names of menus, menu options, toolbar buttons
<i>Italics</i>	Used to denote: references to other parts of this document or other documents. Used for the result of an action

The following icons conventions are used in this document.

Convention	Description
	Caution: This icon is used to indicate that there is a danger to equipment. The danger could be loss of data, physical damage, or permanent corruption of configuration details.
	Warning: This icon is used to indicate that there is a danger of electric shock. This may lead to death or permanent injury.
	Warning: This icon is used to indicate that there is a danger of inhaling dangerous substances. This may lead to death or permanent injury.

Contact Us

UK and Europe +44 1442 242 330 **D-A-CH** +49 431 23284 1 **The Americas** +1 781 740 2223

Middle East +962 6 588 5622 **Asia** +86 21 5240 0077 **Australia and New Zealand** +61 3 9936 7000

www.xtralis.com

Preface

Xtralis recommends the use of chemical filters when chemical adsorption / absorption is required to remove corrosive gases from the sampled airstream prior entering VESDA units.

This Application Note is intended as a guide for the market to improve the product life, safety and performance of a VESDA system that has been selected for use in a hazardous environment. Though the manufacturer's product warranty may be voided by the use of the detector in such corrosive gaseous environments, it is understood that this commercial risk may be deemed acceptable by the market in some applications. Following the recommendations of this Application Note MAY NOT avoid all risks of the product warranty being voided.

Related Products

Chemical filters can be used with all VESDA detectors except VEA.

Copyright© 2018 Xtralis

Contents

1	Introduction.....	1
2	Chemical Filter Assembly.....	2
	2.1 Chemical Filter Impedance / Smoke Transmission	4
3	Chemical Filter Installation.....	5
4	Chemical Filter Commissioning and Maintenance	5
5	Chemical Media Disposal	5
6	Further Support	5

1 Introduction

Corrosive gases have the potential to impact operation and affect the life of VESDA detectors. Corrosion effects include thermal failures, short circuit, metal loss, and are usually accelerated by heat and moisture.

Sources of corrosive gases can be combustion processes, bleaching operations, cleaning compounds, etc. and include acidic gases (H₂S, NO_x, Cl₂), caustic gases (NH₃), oxidizing gases (O₃).

**Note!**

A VESDA detector protecting a corrosive environment and installed outside the protected area is still vulnerable since corrosive gases will be aspirated to the detector via the pipe network.

To protect VESDA detectors against corrosion, the sampled airstream must be “purified” by passing it through a “bed” of chemical media (beads) before it enters the detector.

For effective removal of corrosive gases from the detector airstream, the correct type and quantity of chemical media specific to the type and concentration of gas(es) of concern must be used. Chemical media manufacturers¹ can assist to identify the type and quantity of chemical media by taking into consideration the VESDA pipe network parameters (airstream flowrate / temperature / humidity).

**Note!**

- When more than one corrosive gases are present, a combination of chemical media should be used for each target gas.
- Pipe network components must be chemically resistant against the target gas.
- When detector is mounted outside the protected area, ensure the exhaust air is returned to the protected area.

¹ For example, Purafil (<http://www.purafil.com>)

2 Chemical Filter Assembly

Different chemical filter assemblies can be used with VESDA systems provided (i) flow impedance and (ii) smoke transmission properties are quantified and accounted for in the ASPIRE design. For information on this assessment refer to the *Xtralis Open-flow In-Line Components Application Note (No. 18336)*.

An example of a chemical filter is shown in Figure 1 assembled from commercially available parts (Table 1) comprising (i) 10" standard filter housing, (ii) refillable cartridge.



(i) 10" Standard Filter Housing



(ii) Refillable Cartridge for 10" Standard Filter Housing

Figure 1. Chemical Filter Assembly

Table 1 Chemical Filter Assembly Parts


Part	Brand	Model	Suggested Source
10" Standard Filter Housing 3/4" NPT inlet/outlet ports	Pentek	150072	waterpurification.pentair.com
10" Standard Filter Housing 3/4" BSP inlet/outlet ports	Pentek	150096	www.pentairaquaeurope.com
Refillable Cartridge for 10" Standard Filter Housing	AMI	C-C2510- CLEAR	http://www.wateranywhere.com/product_info.php?products_id=10710



Note!

Select a clear 10" Standard Filter Housing sump to allow for visual inspection of changing chemical media colour.

The refillable cartridge will require a 3-step modification process to accommodate the chemical media as shown in Figure 2.

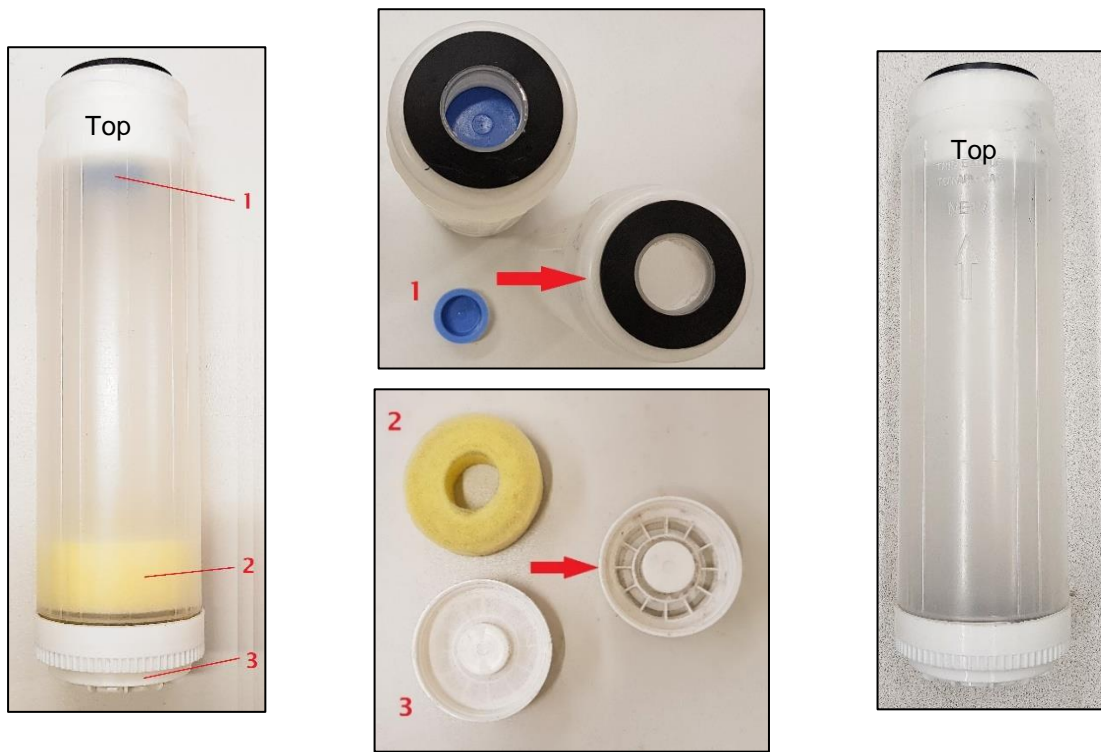

Refillable Cartridge
(Original State)

Step 1: Remove blue cap (push through)

Step 2: Remove PU foam

Step 3: Remove paper pre-filter

Figure 2. Refillable Cartridge Modification

Refillable Cartridge
(Modified)

Once modified, the refillable cartridge is inserted in the 10" filter housing and loaded with chemical media.



Note!

Ensure refillable cartridge is inserted vertically in the filter housing and cap is firmly tighten.

2.1 Chemical Filter Impedance / Smoke Transmission

The inclusion of a chemical filter on the VESDA sampling pipe will affect impedance and smoke transmission which needs to be quantified and accounted for in the ASPIRE design. Detailed information to undertake this assessment is available in the *Xtralis Open-flow In-Line Components Application Note (No. 18336)*.

An example of this assessment is shown below for the chemical filter described in the previous section. The assessment applies to activated carbon chemical media (brand: COL-RPA50, beads: Ø3mm / 4mm length, volume: 400ml i.e. half loaded refillable cartridge, supplier: Carbon Activated Corp., AU).

Accounting for impedance in ASPIRE:

1. Obtain chemical filter pressure/flow relationship (Figure 3).

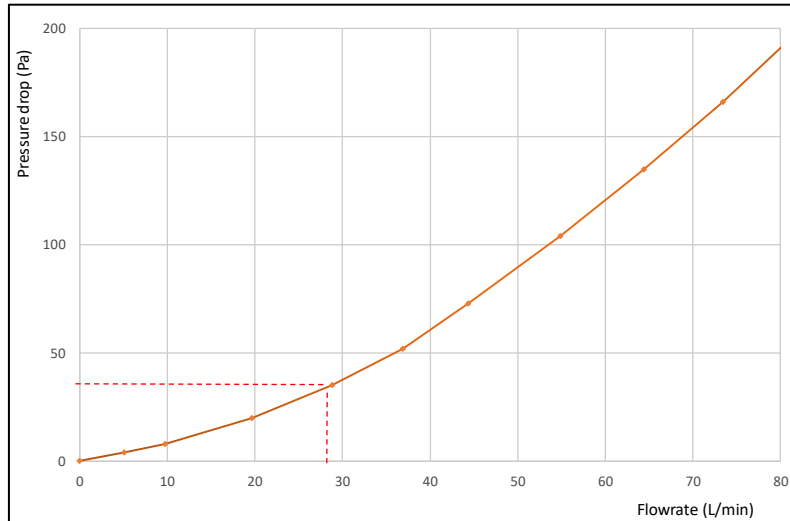


Figure 3. Chemical Filter Impedance Curve

2. Create the initial ASPIRE design (Figure 4). Note the *Pipe Flowrate* for pipe section where chemical filter is intended to be installed i.e. 27.0L/min.

Item	Type	Absolute Distance	Relative Distance	Hole Diameter	Tube Length	Transport Time	Pressure	Flow	Flow%	Hole Sensitivity	Pipe Diameter	Tube Diameter	Direction	Intersection Pressure
	Bend 90	2.67	2.67										L	
	Bend 90	5.34	2.67										F	
1:Section0-1	Hole	8.00	2.66	2.5		8	135	3.6	13.5	1.483	21.0			
1:Section0-2	Hole	13.00	5.00	2.5		11	126	3.5	13.0	1.536	21.0			
1:Section0-3	Hole	18.00	5.00	2.5		15	118	3.4	12.6	1.582	21.0			
1:Section0-4	Hole	23.00	5.00	2.5		19	113	3.3	12.3	1.620	21.0			
1:Section0-5	Hole	28.00	5.00	2.5		25	109	3.3	12.1	1.650	21.0			
1:Section0-6	Hole	33.00	5.00	2.5		32	106	3.2	11.9	1.674	21.0			
1:Section0-7	Hole	38.00	5.00	2.5		43	104	3.2	11.8	1.691	21.0			
1:Section0-8	Endcap	43.00	5.00	2.5		65	103	3.4	12.6	1.588	21.0			

System Parameters: Total Pipe Length 43.0 m, Sector Pressure 154 Pa, Pipe Flowrate 27.0 l/min, Ambient Pressure 0 Pa, Number of Sample Points 8.

Figure 4. ASPIRE – Initial Design

3. From Figure 3, note the pressure value corresponding to 27.0L/min flowrate, i.e. 40Pa.
4. In the initial ASPIRE design, insert the negative value of this pressure (-40Pa) in *Ambient Pressure* and re-calculate (Figure 5).

Item	Type	Absolute Distance	Relative Distance	Hole Diameter	Tube Length	Transport Time	Pressure	Flow	Flow%	Hole Sensitivity	Pipe Diameter	Tube Diameter	Direction	Intersection Pressure
	Bend 90	2.67	2.67										L	
	Bend 90	5.34	2.67										F	
1:Section0-1	Hole	8.00	2.66	2.5		9	99	3.1	13.6	1.470	21.0			
1:Section0-2	Hole	13.00	5.00	2.5		13	92	3.0	13.1	1.527	21.0			
1:Section0-3	Hole	18.00	5.00	2.5		17	87	2.9	12.7	1.576	21.0			
1:Section0-4	Hole	23.00	5.00	2.5		22	82	2.8	12.4	1.618	21.0			
1:Section0-5	Hole	28.00	5.00	2.5		29	79	2.8	12.1	1.653	21.0			
1:Section0-6	Hole	33.00	5.00	2.5		38	76	2.7	11.9	1.682	21.0			
1:Section0-7	Hole	38.00	5.00	2.5		51	74	2.7	11.8	1.701	21.0			
1:Section0-8	Endcap	43.00	5.00	2.5		76	73	2.9	12.5	1.600	21.0			

System Parameters: Total Pipe Length 43.0 m, Sector Pressure 155 Pa, Pipe Flowrate 23.0 l/min, Ambient Pressure -40 Pa, Number of Sample Points 8.

Figure 5. ASPIRE – Chemical Filter Simulation

5. Check and verify system parameters (i.e. holes pressure/flowrate, smoke transport time, etc.). If any parameter is not met, the VESDA system must be modified i.e. increase fan speed, reduce coverage, upgrade to a detector with stronger fan capacity.

Accounting for smoke transmission loss in ASPIRE:

The chemical filter causes a 20% reduction in the concentration of passing smoke. To compensate for this reduction, a 20% adjustment must be applied to the all detector alarm thresholds. For example, if initial Fire Threshold is 0.2%Obs/m, this will be adjusted to 0.16%Obs/m (0.2%Obs/m – 20%).

**Note!**

- Where more than one chemical filters are installed on the same pipe, their respective effects will be cumulative.
- The assessment relates to unused and specific chemical beads and does not account for soiling or other types of chemical beads

3 Chemical Filter Installation

- Chemical filter must be installed in a vertical orientation close to the detector
- Each sampling pipe must have a dedicated chemical filter.
- In dusty/dirty environments install a particulate filter upstream the chemical filter. Refer to *Xtralis In-line Filter Application Note (No. 17785)*.
- Where gas detection is required, install VESDA ECO upstream the chemical filter. Refer to *Xtralis VESDA ECO System Design Guide (No. 20400)*.
- Where water is expected inside the pipe install a water trap upstream the chemical filter. Refer to *Xtralis Removal of Water Condensate Application Note (No. 17405)*.

4 Chemical Filter Commissioning and Maintenance

After installation of the chemical filter or replacement of chemical media, smoke tests must be conducted to verify system performance (smoke detection, smoke transport time) – refer to *VESDA Commissioning Guide (No. 10195)*. Particularly after installation, smoke tests must be conducted monthly until the next scheduled chemical media replacement for smoke detection verification.

The replacement interval for chemical media should follow manufacturer's instructions. Certain chemical media manufacturers² offer laboratory analysis that help establish the life cycle of chemical media and determine replacement interval. A visual check for discoloration of the chemical media can also be used as an indicator for replacement (manufacturer instructions should be followed when adopting this approach).

**Note!**

Monitoring detector airflow should not be used as an indicator of chemical filter loading.

Ensure that chemical filters bear labels stating chemical media installation and replacement date. Record all site maintenance data as per local code and standard requirements.

5 Chemical Media Disposal

While disposed as commercial waste, guidelines set by local regulations must be followed since release of adsorbed chemicals may pose environmental issues.

Consult the manufacturer's Safety Data Sheets (SDS) for handling of unused and spent chemical media.

6 Further Support

Contact an Xtralis office or distributor for further information.

² For example, Purafil (<http://www.purafil.com>)

www.xtralis.com

UK and Europe +44 1442 242 330 **D-A-CH** +49 431 23284 1 **The Americas** +1 781 740 2223

Middle East +962 6 588 5622 **Asia** +86 21 5240 0077 **Australia and New Zealand** +61 3 9936 7000

A Disclaimer about this document, statements about Intellectual Property, Copyrights, and Liability, as well as a General Warning are available in an earlier section of this document.

Doc. 14888_06

VESDA®
by  **xtralis®**